

EXAMPLE

IMAGE SENSING SHOW 2024

Application Form for Electrical Works

	1	2	3	4	5	6	7	Total
AC single phase 100V	500 _W	1100 _W						1600 _W
AC single phase 200V								
AC 3-phase 200V			1800 _W					1800 _W

Spotlight (100W)	1	100 _W
<input type="checkbox"/> Incandescent-lamp color <input checked="" type="checkbox"/> Daylight color		

* Write the position of outlet and layout of the booth.

Example ① is a single phase outlet, ①E is outlet with grounding


① has 2 outlets Note) There is no 3 or 4 outlets

* Write the amount per tap for the quantity of electricity.





* Using multiple tap and extension cords are prohibited.

* The maximum amount for one tap is 1.5kW. The exceed amount will be supplied by the main route.

Drawing Example

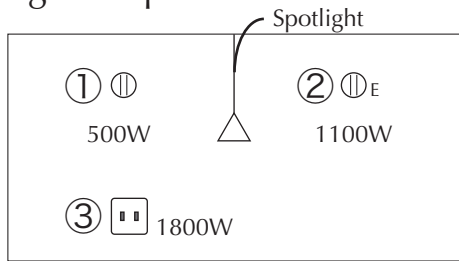

Front

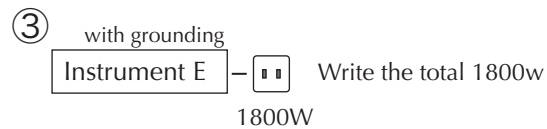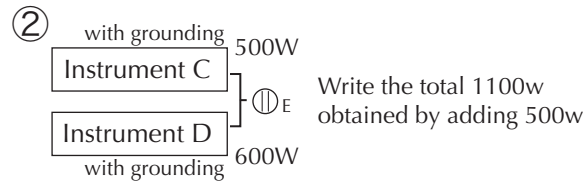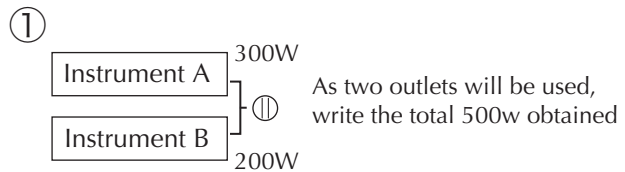

Application Deadline: 10_May 2024(Fri)

Booth No. _____

Company Name _____

Address: _____

Person in Charge : _____

TEL : _____ e-mail : _____

Where to Apply Advance Co.,Ltd
 TIE Hanacho Bldg 6F, 2-61-9 Nihonbashiamacho.Chuo,Tokyo,Japan 103-0007
 e-mail : gazou@adv-ex.jp
 TEL:03-3669-2795 FAX: 03-3669-2668

Person in Charge : Sumiyama & Kato



IMAGE SENSING SHOW 2024

Application Form for Electrical Works

200V Outlets Request sheet

Thank you for exhibiting at IMAGE SENSING SHOW.

Due to the increasing the demands of international types of 200V outlets,
you can choose from the following 2 types if necessary.

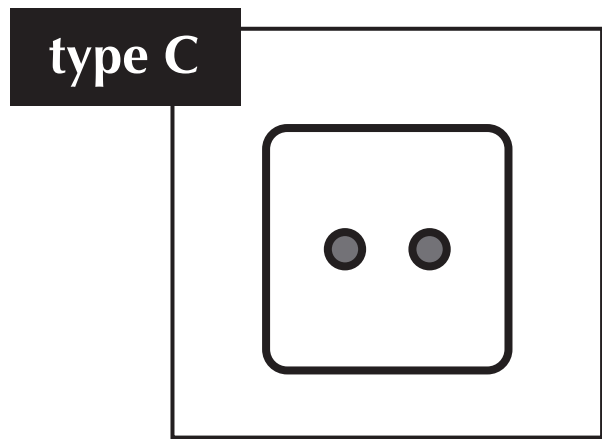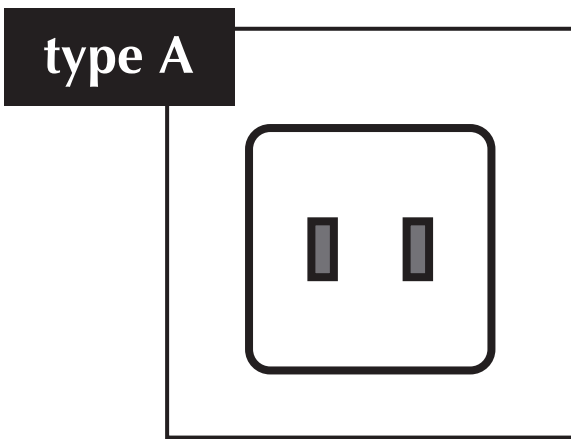

Please fill in your desired type (A or C)

The price for both types are 7,000JPY + 10% tax.

Only these 2 types are available. If you need other types of outlet,
please prepare a suitable conversion adapter by yourself.

Where to Apply Advance Co.,Ltd
TIE Hanacho Bldg 6F, 2-61-9 Nihonbashihamacho.Chuo,Tokyo,Japan 103-0007
e-mail : gazou@adv-ex.jp
TEL:03-3669-2795 FAX: 03-3669-2668




Person in Charge : Sumiyama & Kato

IMAGE SENSING SHOW 2024

Application Form for Electrical Works

	1	2	3	4	5	6	7	Total
AC single phase 100V	W	W	W	W	W	W	W	W
AC single phase 200V	W	W	W	W	W	W	W	W
AC 3-phase 200V	W	W	W	W	W	W	W	W
* Write the position of outlet and layout of the booth. Example ① is a single phase outlet, ①E is outlet with grounding ① has 2 outlets Note) There is no 3 or 4 outlets * Write the amount per tap for the quantity of electricity. * Using multiple tap and extension cords are prohibited. * The maximum amount for one tap is 1.5kW. The exceed amount will be supplied by the main route.							Spotlight (100W)	W
							<input type="checkbox"/> Incandescent-lamp color <input type="checkbox"/> Daylight color	

Outlet Type

100V  200V  or 

Type-A Type-C

Application Deadline: 10_May 2024(Fri)

Booth No. _____

Company Name _____

Address: _____

Person in Charge : _____

TEL : _____ e-mail : _____

Where to Apply Advance Co.,Ltd
 TIE Hanacho Bldg 6F, 2-61-9 Nihonbashiamacho.Chuo,Tokyo,Japan 103-0007
 e-mail : gazou@adv-ex.jp
 TEL:03-3669-2795 FAX: 03-3669-2668
 Person in Charge : Sumiyama & Kato